


INSERT TO DEFINE POINT OF SERVICE



ITEM	QTY	MATERIAL	ITEM	QTY	MATERIAL
	10	Screw, Lag, 1/2" x 2"	-	1	Seal, meter, plastic security
g	1	Rod, Ground, 5/8" Min. Diameter	-	20	Conduit, PVC, 3", Schedule 40
a j	1	Clamp, Ground Rod	-	2	Post Pressure Treated, 6" x 6" x 10'
av	25	Conductor, Service Cable, 350 URD Weslyn	-	3	Stap, 3", Conduit
c j	10	Wire, pole ground, #4 Copperweld, Soft Drawn	-	1	Coupling, 3", PVC
g a	1	Watt-hour meter, 5 dial, electronic, CL 320	-	1	Bushing, 3", PVC
g a	1	Module, Turtle, 240v, #FASY-0584-0002	-	1	Male Adaptor, 3", PVC
g b	1	400A Meter Breaker U4835-X-2/200	-	1	Locknut, 3"
-	1	EII, 3", PVC			

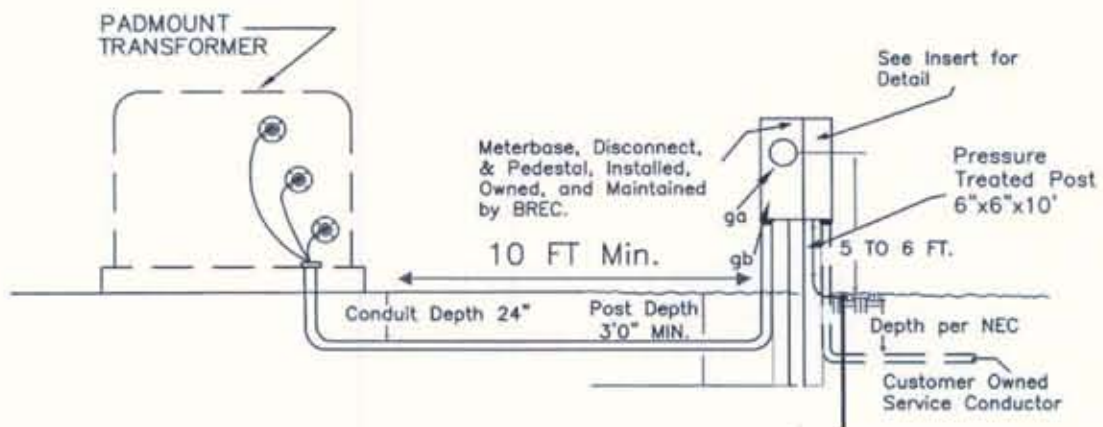

PADMOUNTED TRANSFORMER  
METER BASE COMBO  
400 AMPERE

DATE: 07-13-07

**Q2.400.PAD**